


Reinforcing Requirements



BLOCK $f'_m = 1,500$ psi
 STEEL $f_y = 60,000$ psi
 GROUT $f_c = 2,000$ psi

Brace wall when backfill is done - before structure is framed.

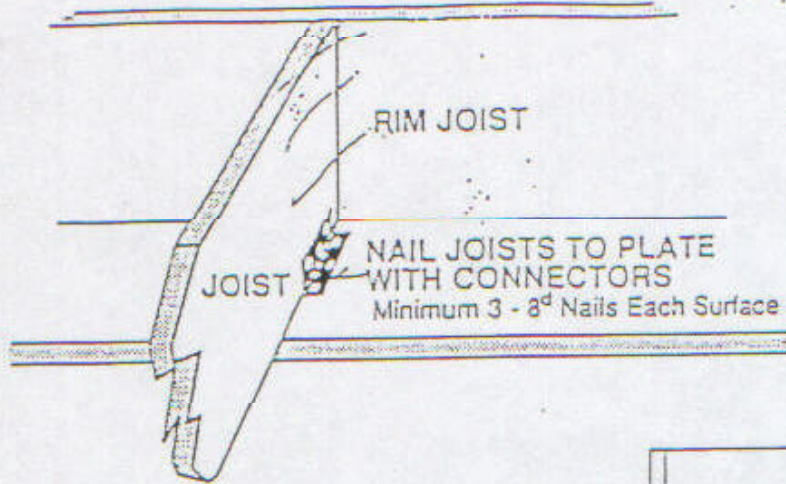